UPS Uninterruptable AC/DC Power Supply

TSPC-240UPS Series

- Compact universal power supply for uniterruptable 24 VDC output voltage
- Battery protection for over voltage, deep discharge, short circuit and reverse connection
- Alarm outputs for input, output and battery condition
- Remote On/Off for UPS function and power supply
- Controlled end of charge voltage by battery temperature sensor
- International safety approval package
- Suitable for various external 12 VDC lead acid batteries







This power supply provides an integrated professional battery management system to charge and monitor an external lead-acid battery. The result is a complete DC-UPS system in a compact housing with no additional parts needed. The external connected 12 V battery will be charged and held in charged mode by the power supply. In the event of a mains power failure the battery will supply the output power until the battery is discharged. To avoid overcharging the battery, an external temperature sensor adjusts the battery voltage automatically to the required end of charge voltage. This can extend the battery life. The battery is protected against deep discharge. Mains power and battery status are monitored regularly and failures indicated by corresponding LED's and alarm outputs. The module also provides an external On/Off input to switch-off both, power supply and battery.

Models				
Order code	Input voltage range	Output current max.*	Output Power max.	Back up battery
TSPC 240-124 UPS	Low Line : 85 – 132 VAC High Line: 187 – 264 VAC	24 VDC / 12 A	240 W	12V lead acid battery (to purchase on local market, no TRACO POWER stocking item)

* Maximum current at nominal Vout

TSPC-240UPS Series

Input Specifications			
Input voltage	– nominal ranges – effective ranges	100 – 120 / 220 – 240 VAC by selection switch 85 – 132 / 187 – 264 VAC (output current derating at low input voltage see page 6	
Input voltage frequency		47 – 63 Hz	
Harmonic limits		EN 61000-3-2	
Holdup time		10 ms min.	
Inrush current		40 A	
Recommended circuit breaker,		16.0 A max. characteristic B or C or slow blow fuse	
Output Specification	15		
Output voltage / current	– normal mode – buffer mode – output power derating above 24 VDC	24.0 – 26.0 VDC; 10 A (12 A in boost mode) 23.4 – 23.8 VDC; 10 A (12 A in boost mode) 5 %/V	
Efficiency (load >50 % of lout max.)	– normal mode – buffer mode	88 – 91 % (battery charged) 90 – 92 %	
Regulation	– Input variation – Load variation (0–100 %)	1 % max. 1 % max.	
Ripple and Noise (20MHz	bandwidth)	100 mVp-p max.	
Overload protection		120 – 140 % of lout nom., constant current	
Short circuit current		90 % of lout nom. (typ.), foldback	
Output overvoltage protect	ion	45 V	
Overtemperature protection		switch off at overtemperature, automatic restart	
Power back immunity		35 V (40 V for 1 sec.)	
Power OK signal	– trigger threshold: – output signal	21.0 – 22.5 V open collector 10 mA max.	
Max. capacitive load		unlimited	
General Specificatio	ons		
Operating temperature	– operation in normal & buffer mode – normal mode boost output – buffer mode boost output	 -25°C to +70°C max. derating above +60°C : 2.5%/K -25°C to +60°C max. derating above +50°C : 1.67 %/K -25°C to +40°C max. 	
Storage temperature		–25°C to +85°C max.	
Temperature coefficient		0.02 %/K	
Cooling		convection cooling, no internal fan	
Pollution degree		2	
Humidity (non condensing)		95 % rel. H max.	
Reliability, calculated MTBF at +25°C acc. to IEC 61709		> 1.1 Mio. h	
Battery protection		against over voltage, deep discharge, overcharge, short circuit and reverse connection (built-in fuse)	
Signals	– Status – Contact rating	DC OK input, DC OK output, BAT OK all relay contact closed and LED on at status OK 30 VDC / 1.0 A max. 60 VDC / 0.5 A max.	

All specifications valid at nominal input voltage, full load and +25°C after warm-up time unless otherwise stated.


TSPC-240UPS Series

Bettery charging current 0.8 – 1.2 A Nominal battery voltage (cit 25°C) 13.6 VDC [lactary setting] Battery voltage adjustment range 13.0 – 14.4 VDC Bottery voltage adjustment range 13.0 – 14.4 VDC Bottery test current 2.5 Å / 60ms typ. [normal mode at 25°C) Battery test current 2.5 Å / 60ms typ. [normal mode at 25°C) Battery test current 2.5 Å / 60ms typ. [normal mode at 25°C) Battery test current 2.5 Å / 60ms typ. [normal mode at 25°C] Battery test current 2.5 Å / 60ms typ. [normal mode at 25°C] Battery test interval [acc. to jumper setting] 10.4 – 11.4 VDC [bufter mode only] Battery avaning Battery avaning 0.102 – 10.2 VDC [bufter mode [see page 6 - connectar] Automatic battery temperature compensation range 1.5°C – 5°C Altitude during oparation Ealabelian 2.5 Å (2000 m Ealabelian 2.5 Å (2000 m) Ealabelian 2.5 Å (2000 m) Ealab	General Specification	ns (continued)			
Bettery voltage adjustment range 13.0 – 14.4 VDC Bettery vestistance test 100mOhm min. (normal mode at 25°C) Battery test current 2.5A / 60ms typ. [normal mode at 25°C] Battery test current 2.5A / 60ms typ. [normal mode at 25°C] Battery vestistance test 100 mOhm min. (normal mode at 25°C) Battery vestistance test 10.4 – 11.4 VDC (buffer mode only) Battery test current 9.3 – 10.2 VDC (buffer mode only) Battery remote Off disconnects battery in buffer mode (see page 6 - connector) Automatic battery temperature compensation range -15°C - 50°C Altitude during operation 2000 m Isolation according to IEC/EN 40950-1, UL 60950-1, UL 508 Safety standards - Information technology equipment - Electrical equipment for mochines - Electronic equipment for mochines - Control equipment for mocarities EN 50178 EN 50178 EN 50178 EN 50178 No 7079-15 10 ATEX 12 69 X www.tracapower.com/over.view/tspc-ups Class of protection IP 20 (IEC/EN 6052) Electronic equipment for mochines - Conducted RI suppression on input - Radiated RI suppression on input - Electronic del suppression on input - Electronic del suppression on input - Electronic Attrinsiter / butti immunity - Electronagenetic compatibiity (E	-		0.8 – 1.2 A		
Battery resistance test 100mOhm min. [normal mode at 25°C] Battery rest current 2.5A / 60ms typ. [normal mode at 25°C] Battery test interval (acc. to jumper setting] 15s or 10min Battery test interval (acc. to jumper setting] 10.4 – 11.4 VDC (buffer mode only) Battery isonnection 9.3 – 10.2 VDC (buffer mode only) Battery isonnection 9.3 – 10.2 VDC (buffer mode only) Battery remote Off disconnects battery in buffer mode lsee page 6 - connector[Automatic battery temperature compensation range -18°C - 50°C Altitude during operation caccording to IEC/EN 60950-1, UL 60950-1, UL 60950-1, UL 60950-1, UL 508 Safety standards - Information technology equipment - Electronic equipment for nozities EVC/EN 60950-1, UL 60950-1, CSA 22.2 No 60950-1-07 - Electronic equipment for nozities EN 60079-15 II3G EX nA IIC T4 - Cantrol equipment for nozities EN 60079-15 II3G EX nA IIC T4 - Cantrol equipment for nozities entification documents - Cantrol equipment for nozities entification documents - Cantrol equipment for nozities EN 60079-15 II3G EX nA IIC T4 - Cantrol equipment for nozities EN 61002-42 - Cantrol equipment for nozities and innumuity EX 1600 - 42 <	Nominal battery voltage (at 25°C)		13.6 VDC (factory setting)		
Battery test current 2.5A / 60ms typ. [normal mode at 25°C] Battery test interval (acc. to jumper setting] 15s or 10min Battery test interval (acc. to jumper setting] 15s or 10min Battery test interval (acc. to jumper setting] 10.4 – 11.4 VDC [buffer mode only] Battery rende Off disconnects bottery in buffer mode (see page 6 - connector) Automatic battery temperature compensation range -15°C - 50°C Altitude during operation 2000 m Isolation accorrel to Bottery in buffer mode (see page 6 - connector) Safety standards - Information technology equipment - Industrial control equipment - Electronic equipment for machines - Electronic equipment for machines EN 60029-1; UL 60950-1; UL 60950-1; UL 508 - Cartification documents www.tracopower.com/overview/tspc-ups Class of protection 26 fety of transformers - Cartoticed equipment for hazardous location EN 61000-63; EN 61204-3 - Cartoticed equipment for bazardous location - Cartotice equipment for bazardous location - Cartotice equipment for bazardous location EN 51002-63; EN 61204-3 Degree of protection IP 20 [EC/EN 60050-1] Degree of protection I					
Battery test interval (acc. to jumper setting) 15s or 10min Battery warning 10.4 – 11.4 VDC (buffer mode only) Battery remote Off disconnects battery in buffer mode (see page 6 - connected) Automatic battery temperature compensation range -15°C - 50°C Altided during operation 2000 m Isolation according to IEC/EN 60950-1, UL 60950-1, UL 508 Safety standards - Information technology equipment - Electrical equipment for machines - Electrical equipment for machines - Electrical equipment for hozardous location - Sofety of transformes - Control equipment for hozardous location - Control equipment for hozardous location - ATEX (for IP 54 enclosure) - Centric testingenession on input - Control equipment for hozardous location - Centrol equipment for hozardous location - Control equipment for hozardous location - Centrol equipment for hozardous location - Control equipment for hozardous location - Centrol equipment for hozardous location - Control equipment for cover installation - Centrel equipment for hozardous location - Control equipment for hozardous location - Centrel equipment for hozardous location - Contoucted RI suppression on input - Con			100mOhm min. (normal mode at 25°C)		
Battery warning 10.4 - 11.4 VDC (buffer mode only) Battery disconnection 9.3 - 10.2 VDC (buffer mode only) Battery disconnection 9.3 - 10.2 VDC (buffer mode only) Battery remote Off disconnects battery in buffer mode (see page 6 - connector) Automatic battery temperature compensation range -15°C - 50°C Altitude during operation 2000 m Isolation according to IEC/EN 60950-1, UL 60950-1, UL 508 Safety standards - Information technology equipment - Electrical equipment for machines EN 60024-1 - Electronic equipment for power installation - Control equipment for paceroliso - Control equipment for paceroliso EN 6029-151/13/G EX nA II/C T4 - Control equipment for paceroliso EN 60029-151/13/G EX nA II/C T4 - Control equipment for machines EN 60029-151/13/G EX nA II/C T4 - Control equipment for paceroliso EN 60029-151/13/G EX nA II/C T4 - Control equipment for macrodus location EN 6002-43 - Control equipment for macrodus location EN 6000-43, EN 61204-3 Electromagnetic compatibility (EMC), Emissions EN 5001 class B, EN 55022 class B, endicide R lauppression on input - Radiated R lauppression on input - Electrical fast transien / burst immunity	Battery test current		2.5A / 60ms typ. (normal mode at 25°C)		
Battery disconnection 9.3 - 10.2 VDC (buffer mode only) Battery disconnection disconnects battery in buffer mode (see page 6 - connector) Automatic battery temperature compensation range -15°C - 50°C Altitude during operation 2000 m Isolation according to IEC/EN 60950-1, UL 60950-1, UL 508 Safety standards - Information technology equipment - Electronic equipment for machines - Electronic equipment for hazardous location - ATEX (for IP 54 enclosure) - Control equipment for hazardous location - ATEX (for IP 54 enclosure) - Control equipment for hazardous location - ATEX (for IP 54 enclosure) - Conducted RI suppression on input - Radiated RI suppression en input - Radiated RI field immunity - Electronic discharge (ESD) EN 61000-4-2 A V V criteria A IEC/EN 61000-4-4 10 V criteria A IEC/EN 6100	Battery test interval (acc. to	jumper setting)	15s or 10min		
Battery remote Off disconnects battery in buffer mode (see page 6 - connected) Automatic battery temperature compensation range -15°C - 50°C Altitude during operation 2000 m Isolation according to IEC/EN 60950-1, UL 60950-1, UL 508 Safety standards - Information technology equipment - Industrial control equipment for machines - Electrical equipment for machines - Electronic equipment for machines - Safety of transformers - Control equipment for box power installation - Not78 - ATEX (for IP 54 anclosure) - Cartification documents - Cartification documents safety class I [EC 536] Degree of protection IP 20 [EC/EN 60950-1] Electronic equipment for hozardous location - Artex (for IP 54 anclosure) - Conducted RI suppression on input - Conducted RI suppression - Radiated RI suppression EN 50011 class B, EN 55022 class B, Electronagnetic compatibility (EMC), timuunity Electronagnetic compatibility (EMC), timuunity - Electrotatic discharge (ESD) - Radiated R field immunity - Electrotatic discharge (ESD) - Electrotatic discharge (ESD) - Radiated RF field immunity - Electrotatic astranisent / burst			10.4 – 11.4 VDC (buffer mode only)		
Automatic battery temperature compensation range -15°C - 50°C Altitude during operation 2000 m Isolation according to IEC/EN 60950-1, UL 60950-1, UL 508 Safety standards - Information technology equipment - Industrial control equipment EEC/EN 60950-1, UL 60950-1, CSA 22.2 No 60950-1-07 - Industrial control equipment EEC/EN 60950-1, UL 508 - Electrical equipment for power installation - Safety of transformers - Control equipment for hazardous location - ATEX [for IP 54 enclosure] - Control equipment for hazardous location - ATEX [for IP 54 enclosure] - Control equipment for machines EN 61058-2-6, EN 61558-2-16 EN 60079-15 II/3G EX AN IIC T4 certificate no. EPS 10 ATEX 1 269 X - Conducted Ruppression on input EN 61000-6-3, EN 61528-2-16 - Conducted Ri suppression on input EN 50011 class B, EN 55022 class B, Electromagnetic compatibility (EMC), Immunity EN 61000-4-2, EN 61204-3 - Electrostatic discharge (ESD) - Radiated RF idel immunity - Betricial last transient / burst immunity - Surge immunity - Surge immunity - Betricial last transient / burst immunity - Boxer frequency field immunity - Roke acc. IEC 60068-2-6; 3 axis, sins sweep, 10			9.3 – 10.2 VDC (buffer mode only)		
Altitude during operation 2000 m Isolation according to IEC/EN 60950-1, UL 60950-1, UL 508 Safety standards - Information technology equipment - Industrial control equipment for moximes Electrical equipment for power installation - Safety of transformers - Control equipment for hazardous location - ATEX (for IP 54 enclosure) - Certification documents - Certification documents www.tracopower.com/overview/tspc-ups Class of protection IP 20 (IEC/EN 60529-1 Degree of protection IP 20 (IEC/EN 60529) Electromagnetic compatibility (EMC), Emissions EN 61000-6-3, EN 61528-216 - Conducted RI suppression on input - Radiated RI suppression - Radiated RF field immunity EN 61000-6-2, EN 61204-3 - Electrostatic discharge (ESD) EN 61000-6-2, EN 61000-4-3, EN 55022 class B, - Radiated RF field immunity - Electrostatic discharge (ESD) - Immunity to conducted RF disturbances EC/EN 61000-4-3, IN V / m - Immunity to conducted RF disturbances IEC/EN 61000-4-4 2 kV - Nains voltage dips and interruptions IEC/EN 61000-4-4 2 kV criteria A Environment - Vibration acc. IEC 60068/2-27 3 axis, sine sweep, 10 - 55 Hz,	Battery remote Off		disconnects battery in buffer mode (see page 6 - connector)		
Isolation according to IEC/EN 60950-1, UL 60950-1, UL 508 Safety standards - Information technology equipment IEC/EN 60950-1, UL 60950-1, CSA 22.2 No 60950-1-07 UL 508, CSA-C22.2 No.107 Electronic equipment for machines EN 60204-1 Electronic equipment for power installation - Sofety of transformers EN 60204-1 Electronic equipment for hazardous location - Control equipment for hazardous location EN 60079-15 IIGG EX An IIC T4 - Control equipment for hazardous location - Certification documents EN 60079-15 IIGG EX An IIC T4 Class of protection IP 20 (IEC/EN 60529) Electromagnetic compatibility (EMC), Emissions - Conducted RI suppression on input - Conducted RI suppression EN 55011 class B, EN 55022 class B, Electromagnetic compatibility (EMC), Immunity EN 61000-6-2, EN 61204-3 IEC/EN 61000-4-3 - Electroid fast transient / burst immunity EC/EN 61000-4-2 IkV / 8 kV criteria B - Surge immunity - Electroid fast transient / burst immunity IEC/EN 61000-4-3 IOV / w criteria A - Nower frequency field immunity - Electrostatic discharge (ESD) IEC/EN 61000-4-4 IkV / 8 kV criteria A - Nower frequency field immunity - Electrostatic discharge (ESD) IEC/EN	Automatic battery temperatu	re compensation range	–15°C – 50°C		
Safety standards Information technology equipment IEC/EN 60950-1, UL 60950-1, CSA 22.2 No 60950-1-07 Safety of transformers Electrical equipment for machines EN 60204-1 Electrical equipment for power installation Safety of transformers EN 60204-1 Control equipment for hazardous location ATEX (for IP 54 enclosure) EN 61558-2-6, EN 61558-2-16 Class of protection Cantrol equipment for hazardous location EN 60029-15 II3G EX nA IIC T4 Class of protection IP 20 (IEC/EN 60529) Electromagnetic compatibility (EMC), Emissions EN 61000-6-3, EN 61204-3 Class of protection IP 20 (IEC/EN 6002-2 dass B, EN 55022 class B, EN 55011 class B, EN 55022 class B, EN 55011 class B, EN 55022 class B, EN 61000-4-3 Electromagnetic compatibility (EMC), Immunity EN 61000-4-3 II V / M criteria B Electrostatic discharge (ESD) IEC/EN 61000-4-3 II V / M criteria B Electrical fast transient / burst immunity IEC/EN 61000-4-3 II V / W criteria B Surge immunity EIC/EN 61000-4-1 I criteria A EV/EN 61000-4-1 I criteria A IEC/EN 61000-4-1 I criteria A IEC/EN 61000-4-1 I criteria A IEC/EN 61000-4-1 I criteria A EV/EN 61000-4-1 I criteria A IEC/EN 61000-4-1 I criteria A IEC/EN 61000-4-1 I criteria A IEC/EN 61000	Altitude during operation		2000 m		
 Industrial control equipment Electrical equipment for machines Electrical equipment for power installation Safety of transformers Control equipment for hazardous location ATEX (for IP 54 enclosure) Certification documents EN 60029-15 II3G EX AA IIC T4 Certification documents EN 60029-15 II3G EX AA IIC T4 Certification documents EN 60029-15 II3G EX AA IIC T4 Certification documents Class of protection Electronagnetic compatibility (EMC), Emissions Conducted RI suppression on input Radiated RI suppression on input Electrostatic discharge (ESD) Electronagnetic compatibility (EMC), Immunity Electrostatic discharge (ESD) Electrostatic discharge (ESD)<!--</td--><td>Isolation</td><td></td><td colspan="3">according to IEC/EN 60950-1, UL 60950-1, UL 508</td>	Isolation		according to IEC/EN 60950-1, UL 60950-1, UL 508		
Degree of protection IP 20 (IEC/EN 60529) Electromagnetic compatibility (EMC), Emissions EN 61000-6-3, EN 61204-3 - Conducted RI suppression EN 55011 class B, EN 55022 class B, - Radiated RI suppression EN 55011 class B, EN 55022 class B, Electromagnetic compatibility (EMC), Immunity EN 61000-6-2, EN 61204-3 - Radiated RF field immunity EN 61000-4-2 4 kV / 8 kV - Radiated RF field immunity EC/EN 61000-4-3 10 V / m - Electrical fast transient / burst immunity IEC/EN 61000-4-4 2 kV - Surge immunity - Electrical fast transient / burst immunity IEC/EN 61000-4-4 2 kV - Nains voltage dips and interruptions IEC/EN 61000-4-5 1 kV / 2 kV criteria A Environment - Vibration acc. IEC 60068-2-6; 3 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min 3 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min Songa complexitient - DIN-rail mounting for DIN-rails as per EN 50022-35x15/7.5 (snap-on with self-locking spring) Environmental compliance - Reach www.tracopower.com/overview/tspc-ups RoHS Connection - Input output battery screw terminal (plug included)	Safety standards	 Industrial control equipment Electrical equipment for machines Electronic equipment for power installation Safety of transformers Control equipment for hazardous location ATEX (for IP 54 enclosure) 	UL 508, CSA-C22.2 No.107 EN 60204-1 EN 50178 EN 61558-2-6, EN 61558-2-16 EN 60079-15 II3G EX nA IIC T4 certificate no. EPS 10 ATEX 1 269 X		
Electromagnetic compatibility (EMC), Emissions EN 61000-6-3, EN 61204-3 - Conducted RI suppression on input - Radiated RI suppression - Radiated RI suppression EN 55011 class B, EN 55022 class B, EN 55022 class B, Electromagnetic compatibility (EMC), Immunity EN 61000-6-2, EN 61204-3 - Electrostatic discharge (ESD) - Radiated RF field immunity - Radiated RF field immunity IEC/EN 61000-4-2 4 kV / 8 kV - Surge immunity - Electrical fast transient / burst immunity IEC/EN 61000-4-3 10 V / m - Surge immunity - Surge immunity IEC/EN 61000-4-4 2 kV criteria B - Nains voltage dips and interruptions IEC/EN 61000-4-8 30 A / m criteria A Environment - Vibration acc. IEC 60068-2-6; 3 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min - Shock acc. IEC 60068-2-27 3 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min - Shock acc. IEC 60068-2-27 3 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min - Shock acc. IEC 60068-2-27 3 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min - Shock acc. IEC 60068-2-27 3 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min - Shock acc. IEC 60068-2-27 3 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min - Shock acc. IEC 60068-2-27 3	Class of protection		safety class I (IEC 536)		
- Conducted RI suppression on input - Radiated RI suppression EN 55011 class B, EN 55022 class B, EN 55011 class B, EN 55022 class B, Electromagnetic compatibility (EMC), Immunity - Electrostatic discharge (ESD) - Radiated RF field immunity - Electrical fast transient / burst immunity - Surge immunity - Surge immunity - Surge immunity - Nains voltage dips and interruptions EN 61000-6-2, EN 61204-3 IEC/EN 61000-4-2 4 kV / 8 kV criteria B IEC/EN 61000-4-3 10 V / m criteria A Environment - Vibration acc. IEC 60068-2-6; - Shock acc. IEC 60068-2-27 1 kV / 2 kV 3 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min 3 axis, 15 g half sine, 11 ms Enclosure material - DIN-rail mounting for DIN-rails as per EN 50022-35x15/7.5 (snap-on with self-locking spring) Environment - Reach - RoHS - Reach - RoHS www.tracopower.com/overview/tspc-ups RoHS directive 2011/65/EU	Degree of protection		IP 20 (IEC/EN 60529)		
- Electrostatic discharge (ESD)IEC/EN 61000-4-24 kV / 8 kVcriteria B- Radiated RF field immunity- Electrical fast transient / burst immunityIEC/EN 61000-4-310 V / mcriteria A- Electrical fast transient / burst immunity- Electrical fast transient / burst immunityIEC/EN 61000-4-42 kVcriteria B- Surge immunity- Immunity to conducted RF disturbancesIEC/EN 61000-4-51 kV / 2 kVcriteria A- Nains voltage dips and interruptionsIEC/EN 61000-4-610 Vcriteria AEnvironment- Vibration acc. IEC 60068-2-6; - Shock acc. IEC 60068-2-273 axis, sine sweep, 10 - 55 Hz, 1 g, 1 oct/min 3 axis, 15 g half sine, 11 ms1 msEnclosure material- DIN-rail mountingfor DIN-rails as per EN 50022-35x15/7.5 (snap-on with self-locking spring)stainless steel (cover)Fnvironmental compliance- Reach - RoHSwww.tracopower.com/overview/tspc-ups RoHS directive 2011/65/EUwww.tracopower.com/overview/tspc-ups RoHS directive 2011/65/EU	- Conducted RI suppression on input		EN 55011 class B, EN 55022 class B,		
- Shock acc. IEC 60068-2-27 3 axis, 15 g half sine, 11 ms Enclosure material aluminium (chassis) / stainless steel (cover) Mounting - DIN-rail mounting for DIN-rails as per EN 50022-35x15/7.5 (snap-on with self-locking spring) Environmental compliance - Reach - RoHS connection - Input output battery	Electromagnetic compatibili	 Electrostatic discharge (ESD) Radiated RF field immunity Electrical fast transient / burst immunity Surge immunity Immunity to conducted RF disturbances Power frequency field immunity 	IEC/EN 61000-4-2 4 kV / 8 kV criteria B IEC/EN 61000-4-3 10 V / m criteria A IEC/EN 61000-4-4 2 kV criteria B IEC/EN 61000-4-5 1 kV / 2 kV criteria B IEC/EN 61000-4-5 1 kV / 2 kV criteria A IEC/EN 61000-4-6 10 V criteria A IEC/EN 61000-4-8 30 A / m criteria A		
Mounting – DIN-rail mounting for DIN-rails as per EN 50022-35x15/7.5 (snap-on with self-locking spring) Environmental compliance – Reach www.tracopower.com/overview/tspc-ups RoHS directive 2011/65/EU Connection – Input output battery screw terminal (plug included)	Environment				
Environmental compliance - Reach www.tracopower.com/overview/tspc-ups - RoHS RoHS directive 2011/65/EU Connection - Input output battery	Enclosure material		aluminium (chassis) / stainless steel (cover)		
- RoHS RoHS directive 2011/65/EU Connection - Input output battery screw terminal (plug included)	Mounting	– DIN-rail mounting			
	Environmental compliance				
	Connection				

All specifications valid at nominal input voltage, full load and +25°C after warm-up time unless otherwise stated.

Function Specification

Function Diagram:

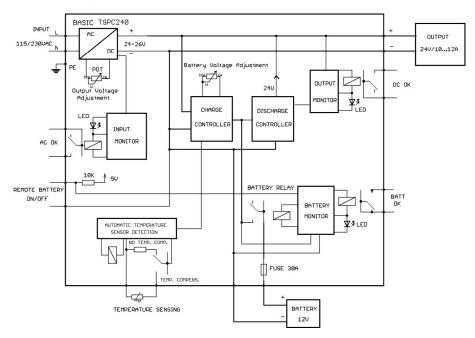

General Description

This power supply is supplied by mains voltage and contains an integrated DC uninterruptible power supply feed by an external battery. It is designed to supply the applied load continuously and without interruption, even when the mains power fails. In this case, the energy is supplied from an external 12V battery to provide the required output voltage. The unit is designed to operate with lead-acid batteries

Operation

Before the first use, the AC input range should be set by the slide switch. During the normal operation, when the input AC voltage is present, the output DC voltage is delivered by internal AC/DC power supply.

In case of power failure the internal battery discharge regulator is activated. The output voltage will be still maintained at the reduced level of 23.6V (typically at Vnom) without any interruptions. The battery discharge operation will continue until AC input voltage recovers.

If the input AC voltage does not recover, the battery voltage will continue to drop, while continuously delivering the output power at required voltage level. In order to prevent the deep discharge of the battery, which can lead to battery failure, the battery is disconnected at the deep discharge threshold. The BAT OK signal will be OFF when the battery voltage is approaching the disconnection voltage level. This can enable early warning of the system.

If the input AC is present at the right level, the battery is automatically charged to the set voltage level. This level is factory set for 25°C for lead-acid batteries. The user can change this voltage by using the built-in potentiometer. The adjustment can be made only if the battery is disconnected (after initial operation) to prevent from adjustments errors. The battery test interval should be set to 10 minutes (factory settings). If the battery is operating at a different ambient temperature (not 25°C), the user can adjust the set battery voltage to the required ambient temperature, as recommended by the battery manufacturer.

After adjustments – the battery should be re-connected. It is also possible to use the temperature compensation probe to automatically compensate the end battery charge voltage for any temperature changes. In this case, there is no need to change the potentiometer to compensate for a new ambient temperature.

The internal state of charge of the battery is tested at regular intervals with internal current pulse. The interval is factory set to 10 minutes. It can be changed to 15s for test purposes by changing the slide switch position on the front of the unit as indicated on the label. If the battery OK signal is OFF, even after prolonged charging, the battery pack needs replacement. The buffer function (during input power failure) can be disabled remotely, and the battery is disconnected. It can be achieved by pulling the Remote ON/OFF pin to GND (with contact relay or transistor).

Function Specification (continued)


Signals

Following signals are made available as LED indicators and corresponding isolated relay contacts:

AC-OK Indicates if the input AC voltage is present. During operation outside the DC specification (overload), at low input AC levels (below nominal range) it can be OFF. It will indicate that the battery operation has started in order to maintain the output voltage at 24V level.
 BATT-OK: Indicates if the battery is charged properly and has low internal resistance. During battery discharge operation this signal monitors the battery voltage. If the battery voltage approaches the disconnection voltage – it is OFF. This ena bles early warnings of the system. The threshold of this signal is about 1V higher than the battery disconnection voltage. Note that if the battery signal was OFF during the normal operation (when input voltage is present) – it will stay OFF during the battery discharge operation as well.
 DC-OUT-OK: Indicates that the output voltage is higher than 82–90% of the nominal output voltage.

Battery

When the input AC voltage is present, the TSPC-240UPS unit will automatically charge the connected battery to a set end of battery charge voltage level, factory set for 25° C for lead-acid batteries, using a constant current charging method of 1A (typical). As the battery voltage approaches the end of battery charge voltage level, the current will decrease proportionally; this characteristic is shown in Fig 1. The user can adjust the set end of battery charge voltage level by means of the "Battery Voltage Adjust" potentiometer. The module also provides an input connector for a temperature compensation probe. If this probe is connected, the unit will automatically compensate the end of battery charge voltage level depending on the measured temperature. The connection of the temperature probe also negates the need to change the potentiometer to compensate for a new temperature. The battery end voltage compensation curve is shown in Fig. 2. (Applicable to factory setting of 13.6V/ 25° C)

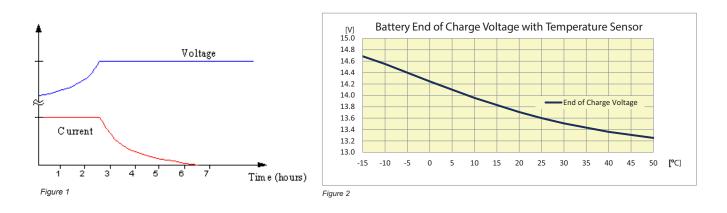

Battery Protection

The module protects the connected battery against short circuit and overload by the means of a built in 30A fuse. This fuse is a standard 30A blade type fuse, which is accessible from the front panel of the unit for ease of replacement should the fuse be damaged during operation.


It also prevents deep discharge of the battery by disconnecting the battery from the load once the voltage level of battery has dropped below a defined threshold. An early warning of this disconnection is given to the user by means of the BATT-OK signal (see chapter 2.6.2). The BATT-OK signal will switch off when the battery voltage is roughly 1V above the deep discharge threshold.

Function Specification (continued)

Remote On/Off


The TSPC-240UPS module provides a Battery Remote on/off input (2 pins on signalconnector); if this input is short circuited (switch closed in Fig. 3) the battery will be disconnected from the unit by means of an internal relay. A voltage of 0.5V or less across the Battery Remote on/off terminals will disconnect the battery from the unit. If the Battery Remote On/Off signal is set to off (short between pins) this will not affect the output of the unit in normal mode, however the battery will be disconnected, hence it will not charge. If the unit enters buffer mode while the Battery Remote On/Off signal is off, the battery will remain disconnected, hence no energy will be supplied to the load.


Battery State Battery Remote On/Off Pins		Voltage
Connected	Open Circuit	5V
Disconnected	Short Circuit	< 0.5V





Ambient temperature and power rating

The module operates at temperatures between -10° C and $+60^{\circ}$ C, with a minimum start-up temperature of -25° C. In normal mode the module can deliver full power up to 60° C. The boost current of 12A is available at ambient temperatures up to 50° C with a derating of $1.67\%/^{\circ}$ C for temperatures above 50° C, as shown in Fig. 4. In buffer mode the module can deliver full power up to 60° C with the boost current of 12A available at ambient temperatures up to 40° C as shown in Fig. 5.

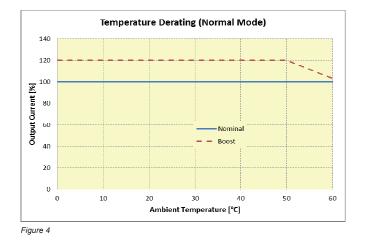


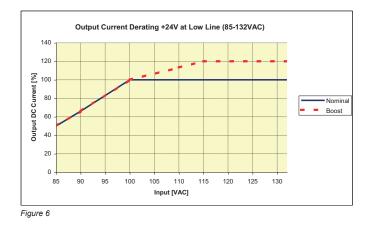

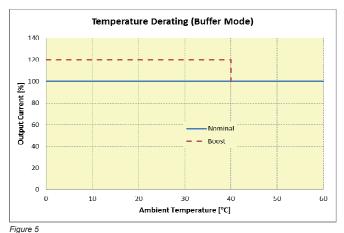


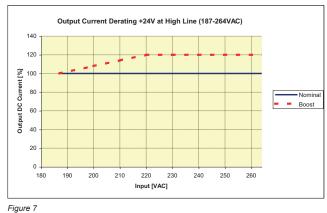

Connector Position

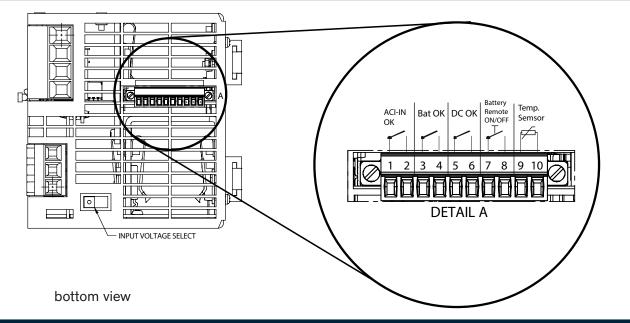

Outline Dimensions

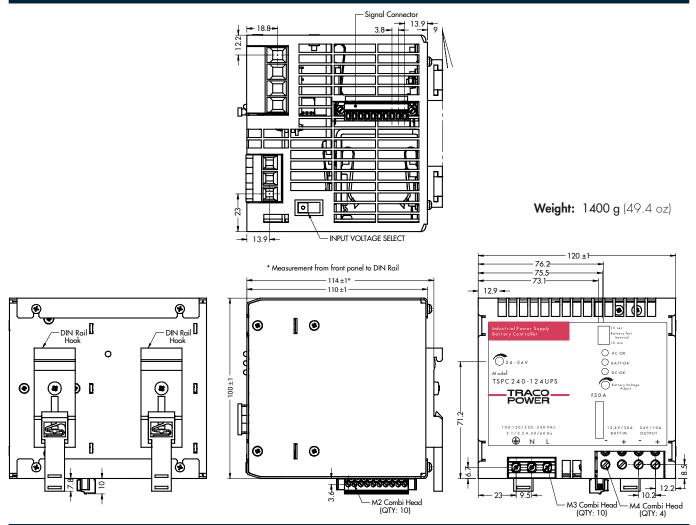

© Copyright 2017 Traco Electronic AG

TRACO POWER

www.tracopower.com