

Energy Management Energy Meter Type EM23 DIN




- Class 1 (kWh) according to EN62053-21
- Class B (kWh) according to EN50470-3
- Class 2 (kvarh) according to EN62053-23
- Accuracy ± 0.5 RDG (current/voltage)
- Energy analyzer
- Instantaneous variables readout: 3 DGT
- Energies readout: 6+1 DGT
- System variables: W, var, Phase-sequence.
- Single phase variables: A
- Energy measurements: total kWh and kvarh
- TRMS measurements of distorted sine waves (voltages/currents)
- Self power supply
- 1 pulsating output
- Dimensions: 4-DIN modules
- Protection degree (front): IP50
- Easy connections management

Product Description

Three-phase energy meter with built-in configuration joystick and LCD data displaying; particularly indicated for active and reactive energy metering and for cost allocation. Housing for DIN-rail mounting with IP50

(front) protection degree. Direct connection up to 65A. Moreover the meter is provided with one pulsating output proportional to the active energy being measured.

How to order **EM23 DIN AV9 3 X 01 X**

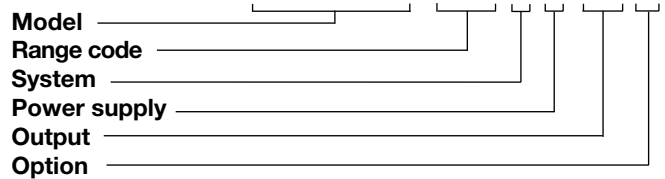

Type Selection

Range codes	System	Output	Power supply
AV9: 400V _{LL} AC - 10(65)A (Direct connection)	3: balanced and unbalanced load: 3-phase, 4-wire; 3-phase, 3-wire;	01: open collector type (single pulse output)	X: Self power supply -15% +20% of the rated measuring input voltage, 45 to 65 Hz

Options

X: none

Input specifications

Rated inputs	System type: 3		
Current type	By direct connection		
Voltage	400 V _{LL} AC		
Current range (direct)	10 (65)AAC		
Accuracy (Display) (@25°C ±5°C, R.H. ≤60%, 48 to 62Hz) AV9 model	Ib: see below, Un: see below		
	Ib: 10A, I _{max} : 65A; Un: 184 to 276VLN (318 to 480VLL)		
Current	From 0.004Ib to 0.2Ib: ±(0.5% RDG +3DGT) From 0.2Ib to I _{max} : ±(0.5% RDG +1DGT).		
Phase-neutral voltage	In the range Un: ±(0,5% RDG +1DGT)		
Phase-phase voltage	In the range Un: ±(1% RDG +1DGT)		
Active power	±(1%RDG +2DGT)		
Reactive power	±(2%RDG +2DGT)		
Active energy	Class 1 according to EN62053-21 and Class B according to EN50470-3		
Reactive energy	Class 2 according to EN62053-23 Ib: 10A, I _{max} : 65A; 0.1 Ib: 1,0A, Start up current: 40mA		
Energy additional errors			
Influence quantities	According to EN62053-21, EN62053-23 and EN50470-1-2		
Temperature drift	≤200ppm/°C		
Sampling rate	1600 samples/s @ 50Hz 1900 samples/s @ 60Hz		
Display refresh time	750 msec.		
Display	2 lines (1 x 7 DGT; 1 x 3DGT)		
Type	LCD, h 9mm		
Instantaneous variables read-out	3 DGT		
Energies	Imported: 6+1DGT or		
		Overload status	7DGT; EEE indication when the value being measured is exceeding the "Continuous inputs overload" (maximum measurement capacity)
		Max. and Min. indication	Max. instantaneous variables: 999; energies: 999 999.9 or 9 999999. Min. instantaneous variables: 0; energies 0.0
		LEDs	Red LED (Energy consumption), 1000 imp./kWh Max frequency: 16Hz according to EN50470-1
		Measurements	See "List of the variables that can be connected to:"
		Method	TRMS measurements of distorted wave forms.
		Coupling type	Direct
		Crest factor	Ib 10A ≤4 (91A max. peak)
		Current Overloads	
		Continuous	65A, @ 50Hz
		For 10ms	1920A max, @ 50Hz
		Voltage Overloads	
		Continuous	1.2 Un
		For 500ms	2 Un
		Input impedance	
		400VL-L	Refer to "Power Consumption"
		10(65) A	< 4VA
		Frequency	45 to 65 Hz
		Joystick	For variable selection.

Output specifications

Digital outputs		Static output	
Pulse type		Purpose	For pulse output
Number of outputs	100 pulses per kWh (0.01kWh/pulse).	Signal	V _{ON} 1.2 VDC/ max. 100 mA V _{OFF} 30 VDC max.
Type	Output connected to the active energy	Insulation	By means of optocouplers, 4000 VRMS between output to measuring inputs.
Pulse duration	≥100ms < 120msec (ON), ≥120ms (OFF), according to EN62052-31		

Software functions

System selection System 3-Phase unbalanced load	3-phase (4-wire); 3-phase (3-wire).	Both energy and power measurements are independent from the current direction. The displayed energy is always "imported"
Displaying	Up to 3 variables per page	
Easy connection function	Automatic phase sequence detection with current and voltage synchronisation.	

General specifications


Operating temperature	-25°C to +55°C (-13°F to 131°F) (R.H. from 0 to 90% non-condensing @ 40°C) according to EN62053-21 and EN62053-23	Radio frequency suppression	According to CISPR 22
Storage temperature	-30°C to +70°C (-22°F to 158°F) (R.H. < 90% non-condensing @ 40°C) according to EN62053-21 and EN62053-23	Standard compliance	
Installation category	Cat. III (IEC60664, EN60664)	Safety	IEC60664, IEC61010-1 EN60664, EN61010-1 EN62052-11
Insulation (for 1 minute)	4000 VRMS between measuring inputs and digital output	Metrology	EN62053-21, EN62053-23, EN50470-3
Dielectric strength	4000 VRMS for 1 minute	Pulse output Approvals	DIN43864, IEC62053-31 CE
Noise rejection CMRR	100 dB, 48 to 62 Hz	Connections	
EMC	According to EN62052-11	Cable cross-section area	Screw-type Max. 16 mm ² Min. 2.5 mm ² (measuring inputs); Min./Max. screws tightening torque: 1.7 Nm / 3 Nm Output terminals: 1.5 mm ² Min./Max. screws tightening torque: 0.4 Nm / 0.8 Nm
Electrostatic discharges Immunity to irradiated	15kV air discharge; Test with current: 10V/m from 80 to 2000MHz;	Housing DIN	
Electromagnetic fields	Test without any current: 30V/m from 80 to 2000MHz;	Dimensions (WxHxD)	71 x 90 x 64.5 mm
Burst	On current and voltage measuring inputs circuit: 4kV	Material	Nylon PA66, self-extinguishing: UL 94 V-0 DIN-rail
Immunity to conducted disturbances	10V/m from 150KHz to 80MHz	Mounting	
Surge	On current and voltage measuring inputs circuit: 4kV.	Protection degree	
		Front	IP50
		Screw terminals	IP20
		Weight	Approx. 400 g (packing included)

Power supply specifications


Self supplied version	"O1" option only: -15% +20% of Un, 48-62Hz.	in a 3-phase system with neutral may work also if one or two phases are missing.
Note	The instrument provided with "O1" option, working	
	Power consumption	≤20VA/1W

Accuracy (according to EN50470-3 and EN62053-23)

kWh, accuracy (RDG) depending on the current

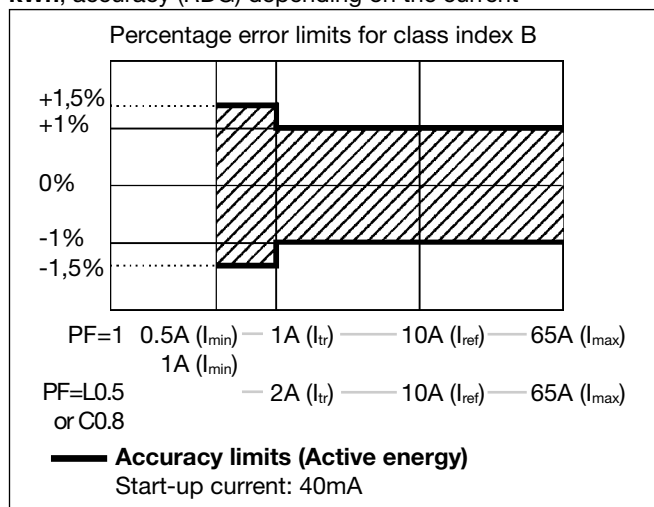

kvarh, accuracy (RDG) depending on the current

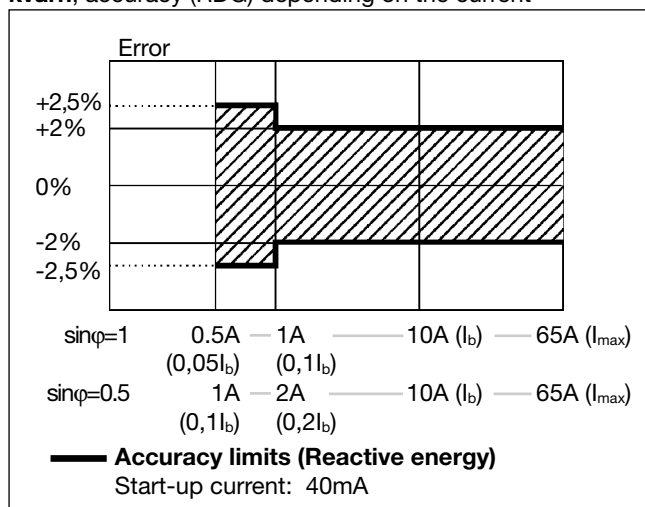

EN50470-3 compliance

Accuracy

$0.9 U_n \leq U \leq 1.1 U_n$;
 $0.98 f_n \leq f \leq 1.02 f_n$;
 f_n : 50 or 60Hz;
 $\cos\phi$: 0.5 inductive to 0.8 capacitive.
 Class B
 I_{st} : 0.04A;
 I_{min} : 0.5A;
 I_{tr} : 1A;
 I_{max} : 65A.

Operating temperature

-25°C to +55°C (-13°F to 131°F) (R.H. from 0 to 90% non-condensing @ 40°C)

EMC compliance

E2

List of the variables that can be connected to:

- Pulse output (only "Energies")

No	Variable	3-ph. 4-wire bal. system	3-ph. 4-wire unbal. system	3 ph. 3-wire bal. system	3 ph. 3-wire unbal. system	Notes
1	A L1	x	x	x	x	
2	A L2	x	x	x	x	
3	A L3	x	x	x	x	
4	var sys	x	x	x	x	sys=system
5	W sys	x	x	x	x	sys=system
6	Phase seq.	x	x	x	x	
7	kWh	x	x	x	x	Total
8	kvarh	x	x	x	x	Total

(x) = available

(o) = not available (zero indication on the display)

Display pages

Display variables in 3-phase systems with or without neutral




No	1 st line	2 nd line	Phase Sequence	Notes
1	Total kWh	kW sys	Warning triangle if reverse sequence	
2	Total kvarh	kvar sys	Warning triangle if reverse sequence	
3	AL1 - AL2	AL3	Warning triangle if reverse sequence	

Note: whatever page the user has selected, after 60s it goes back to page 1.

Insulation between inputs and outputs


	Measuring Inputs	Open collector outputs	Self power supply
Measuring Inputs	-	4kV	0kV
Open collector outputs	4kV	-	4kV
Self power supply	0kV	4kV	-

Wiring diagrams

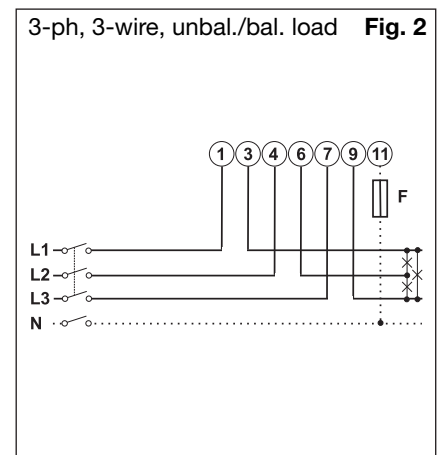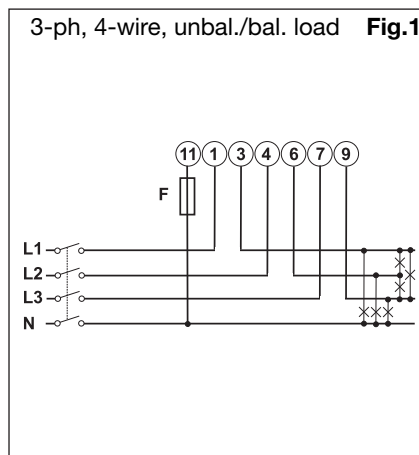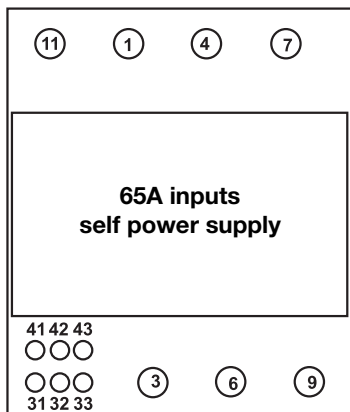


Open collector output wiring diagrams

Open Collector



GND reference


Open Collector



VDC reference

The load resistances (R_c) must be designed so that the close contact current is lower than 100mA; the VDC voltage must be lower than or equal to 30VDC.

Front panel description

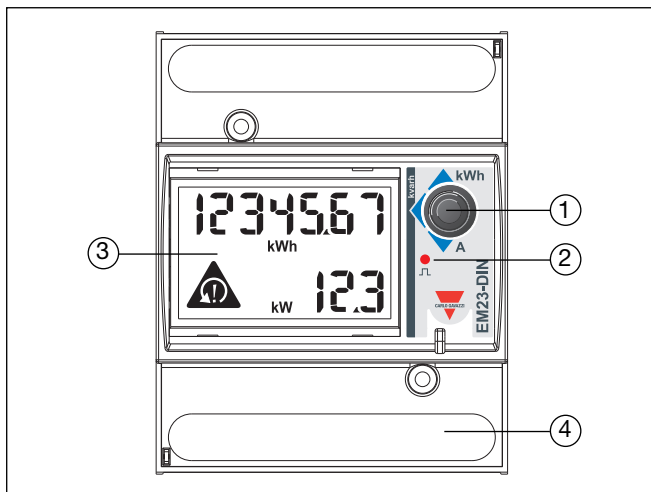

1. **Joystick**
To scroll the variables on the display.
2. **LED**
Red LED blinking proportional to the energy being measured.
3. **Display**
LCD-type with alphanumeric indications to display all the measured variables.
4. **Connections**
Screw terminal blocks for instrument wiring.

Dimensions

